



Catalog Number	BIL	Stud View	Stud Type	AMPS	Standard Voltage Class
9U03TPS150	150	A	Standard	200	35kV
9U03TPR150	150	B	Removable	200	35kV

**UNLESS OTHERWISE SPECIFIED, ERMCO COMPONENTS**

SURFACES	TOLERANCES		
	2 PL DEC	3 PL DEC	ANGLES
✓	±.010	±.005	±.5°

THE INFORMATION CONTAINED ON THIS DOCUMENT IS PROPRIETARY TO ERMCO COMPONENTS AND MAY NOT BE USED FOR ANY OTHER PURPOSES THAN THOSE EXPRESSLY AUTHORIZED BY ERMCO.

DWG NO. 2B038010P00  
SH 1 NUMBER OF SHS. 1  
TITLE: Outline (HVBW 150BIL)  
FIRST MADE FOR: HV Bushing Well

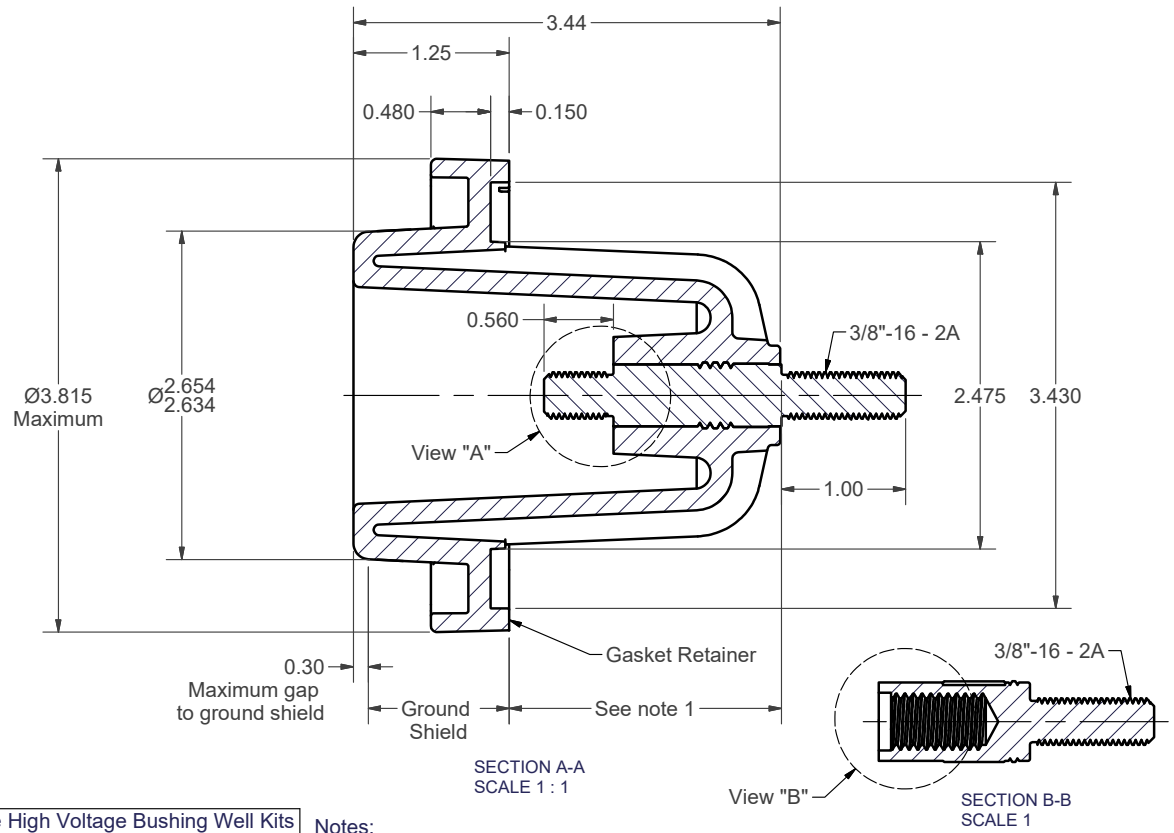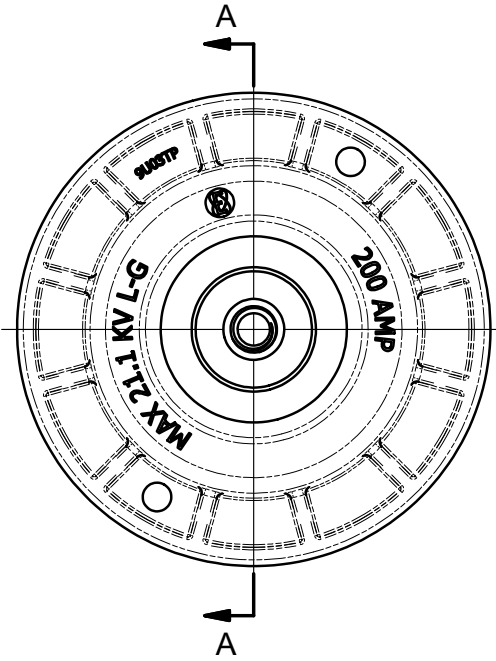

Catalog Number	Bushing Well	Gasket	Stl. Clamp w/ Zinc	Stn. Stl. Clamp
9U03TPS150	X			
9U03TPS151	X	X		
9U03TPS152	X	X	X	
9U03TPS153	X	X		X
9U03TPS154	X		X	
9U03TPS155	X			X

Catalog Number	Bushing Well	Gasket	Stl. Clamp w/ Zinc	Stn. Stl. Clamp
9U03TPR150	X			
9U03TPR151	X	X		
9U03TPR152	X	X	X	
9U03TPR153	X	X		X
9U03TPR154	X		X	
9U03TPR155	X			X

Notes:

- This section should be completely immersed under a suitable head of oil
- For removable stud type - use a 13/16" socket to replace stud, insert 7/16"-14 threaded end first and torque to 100 in-lbs. Backout torque to 60 in-lbs minimum.

Order removable studs separately (9U09AAW270)

DRAWN BY: Nicholas Adams	ECN N056 6/19/2023	APPROVAL		DWG NO. 2B038010P00
ISSUED BY: Nicholas Adams	6/19/2023			SH 1 NUMBER OF SHS. 1

300003-135