

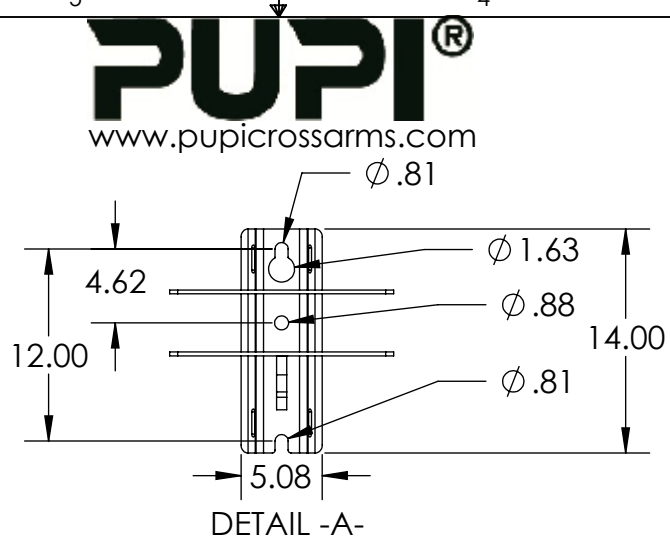
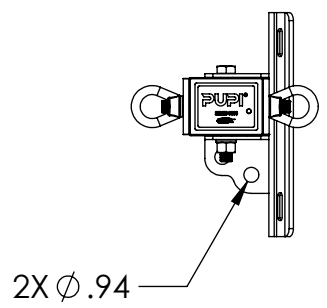
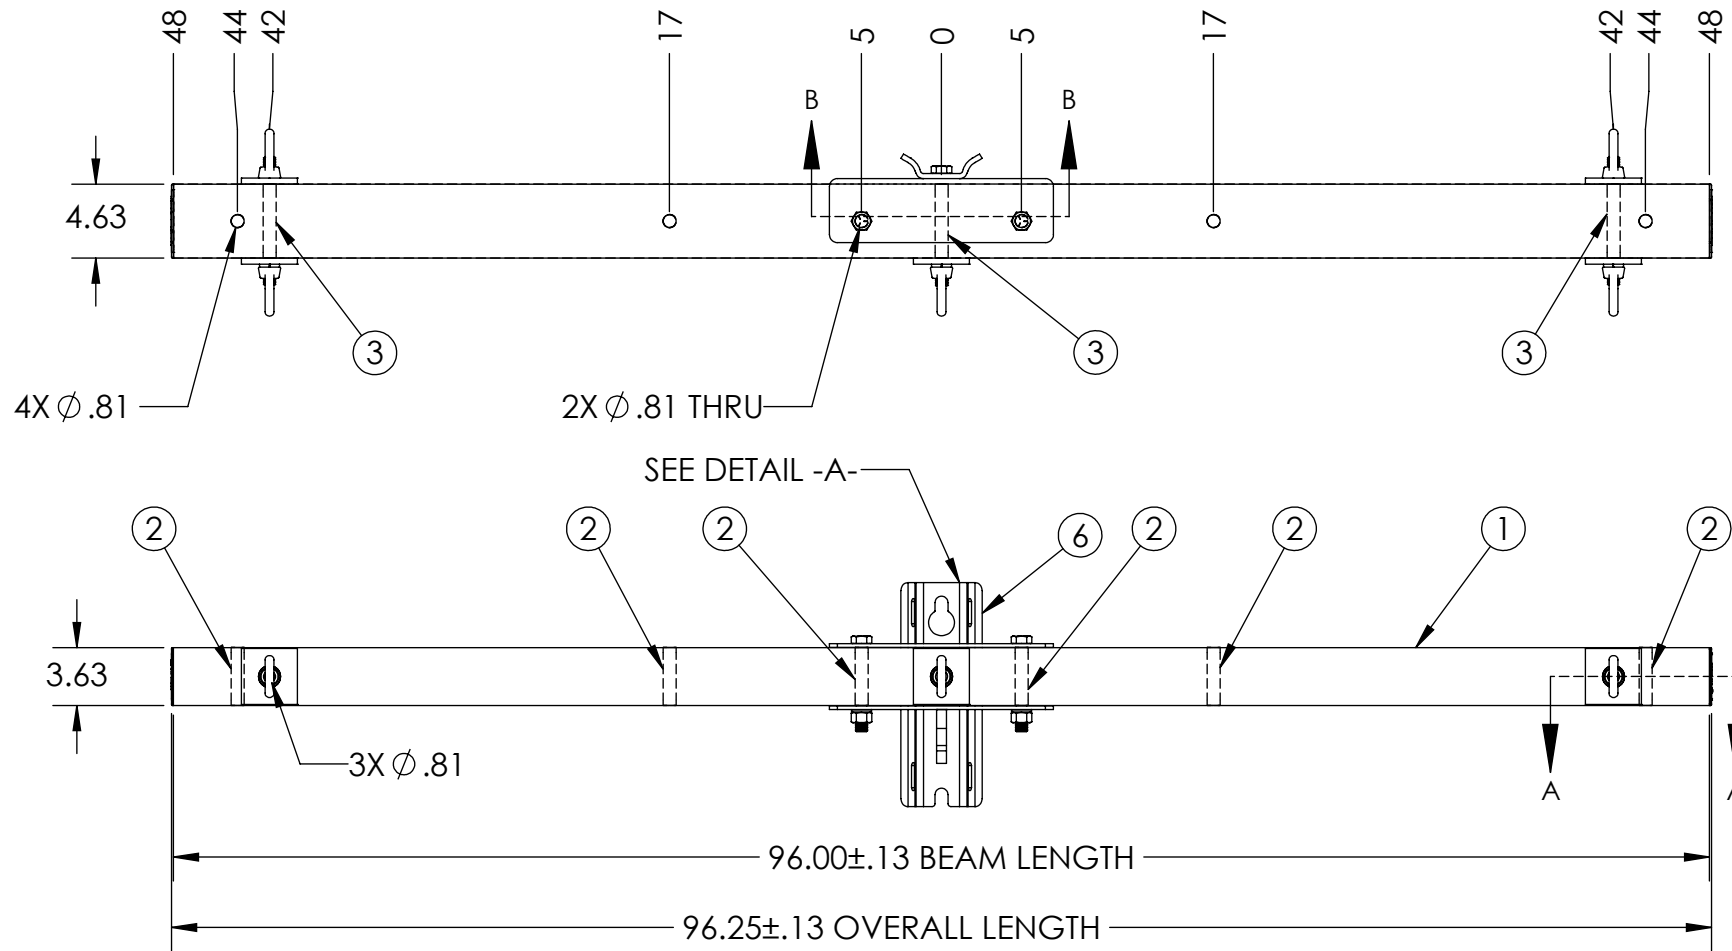


ITEM NO.	PART NUMBER	DESCRIPTION	DESCRIPTION 2	QTY
1	FB-096-3000-2	BEAM, PULTRUDED STOCK	SERIES 3000 x 96 in, GRAY	1
2	TG0813-0042	BUSHING	13/16 in x 3 in	6
3	TG0813-0041	BUSHING	13/16 in x 3-15/16 in	3
4	FOAM	-	-	1
5	EC30-0002-2	END CAP	SERIES 3000, GRAY	2
6	DM-0033	MOUNT ASSEMBLY, DEADEND	HDLH	1
7	HB0750-0001	HEX BOLT	3/4 in - 10 x 5-1/2 in	2
8	LW0750-0001	LOCK WASHER	3/4 in	5
9	HN0750-0001	HEX NUT	3/4 in - 10	2
10	HB0750-0012	HEX BOLT	3/4 in - 10 x 7 in	1
11	SW0813-0003	SQUARE WASHER	13/16 in, 3-1/2 in x 3/8 in	5
12	EN0750-0002	EYE NUT	3/4 in - 10	5
13	TR0750-0002	THREADED ROD	3/4 in - 10 x 8 in	2

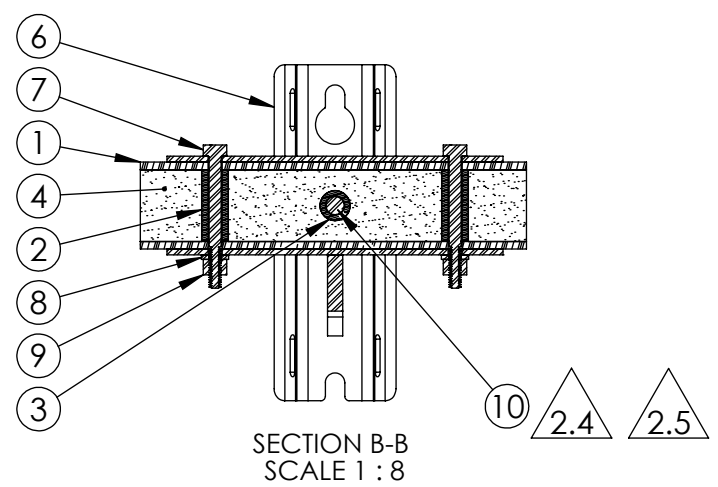

REVISIONS				
ECO	REV.	DESCRIPTION	DATE	INITIALS
	2.4	REPLACE HB0750-0004 WITH HB0750-0012	2015-03-06	RAF
	2.5	CORRECT ACTION TAKEN IN REVISION 2.4	2015-04-10	RAF
1351	2.6	UPDATE DRAWING FORMAT	2016-01-15	RAF
3096	2.7	ADD LOAD RATINGS	2017-04-06	RAF
3439	2.8	UPDATE DRAWING VIEWS	2017-07-12	AJH
	2.9	CORRECT LOADING NOTES NOTATION	2020-11-09	BMR
	2.10	CORRECT LOADING NOTES NOTATION	2022-02-25	CJM
6496	2.11	UPDATE DRAWING FORMAT	12/8/2023	AJH

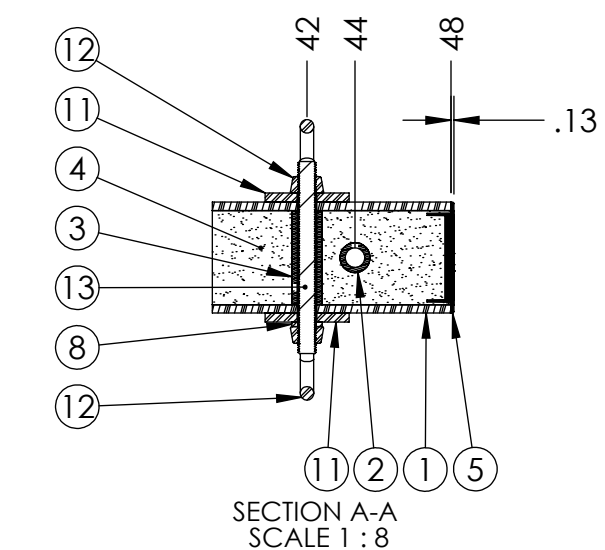

NOTES:
1. CENTER OF MOUNT HOLE(S) TO HOLES TOLERANCE ±0.06
2. CALCULATED AVERAGE ULTIMATE VERTICAL LOAD = 6,500 LBS PER WIRE, 3 WIRES
3. CALCULATED AVERAGE ULTIMATE LONGITUDINAL LOAD = 14,000 LBS PER WIRE, 3 WIRES
4. CALCULATED AVERAGE ULTIMATE TRANSVERSE LOAD = 12,000 LBS PER SIDE
5. GEOTEK RECOMMENDS MAXIMUM APPLIED LOAD PER WIRE DOES NOT EXCEED 50% OF THE AVERAGE ULTIMATE STRENGTH PER WIRE OF THE CROSSARM.

---UNLESS OTHERWISE SPECIFIED---		
DIMENSIONS ARE IN INCHES INTERPRET DIM AND TOL PER ASME Y14.5-2009 ANGULAR: MACH ±2° BEND ±2° ONE PLACE DECIMAL ±0.1 TWO PLACE DECIMAL ±0.02		
PROPRIETARY AND CONFIDENTIAL THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF GEOTEK. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF GEOTEK IS PROHIBITED.		
CUSTOMER SIGNATURE: _____ DATE: _____		
THIRD ANGLE PROJECTION		
-REFERENCES- pupicrossarms.com/warranty geotek.com/termsandconditions		
STATE: RELEASED	2023-12-13	
DRAWN: RAF	2013-03-18	
CHECKED: STK	2023-12-12	
APPROVED: AJH	2023-12-13	
REPLACES: DA3000-96E3-B7X		



1421 SECOND AVE NW
STEWARTVILLE, MN 55976
(800) 533-1680
www.geotek.com

DESCRIPTION:
DEADEND ASSEMBLY, SERIES 3000
96 in, PUPPI B7X

SIZE: DWG. NO. **B DA3000096E3B7X2**

BEAM COLOR: **GRAY**

REV: **2.11**

SCALE: 1:12 | WEIGHT: 65 LBS

SHEET 1 OF 1