
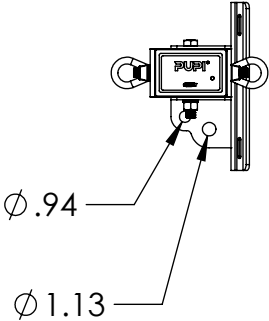
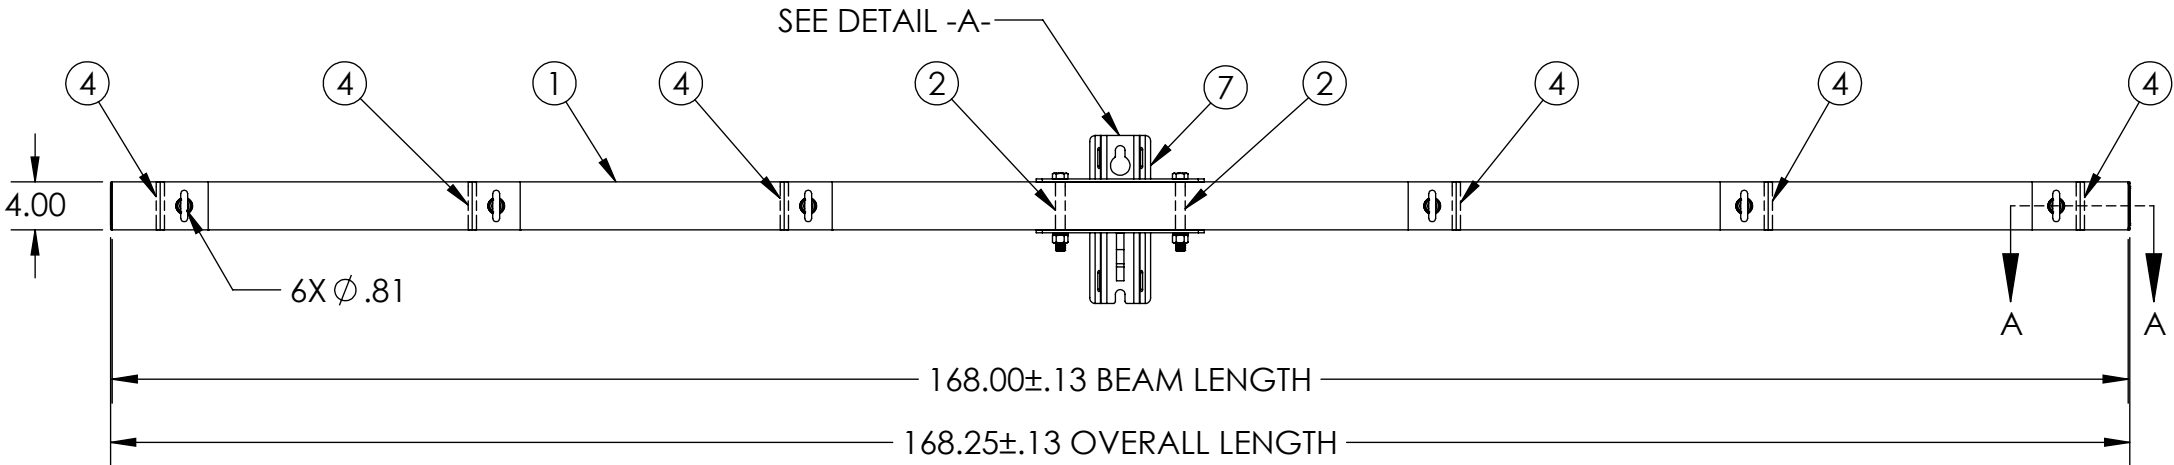
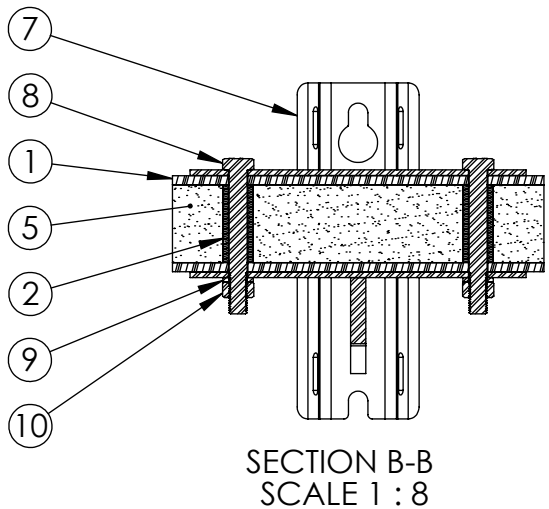
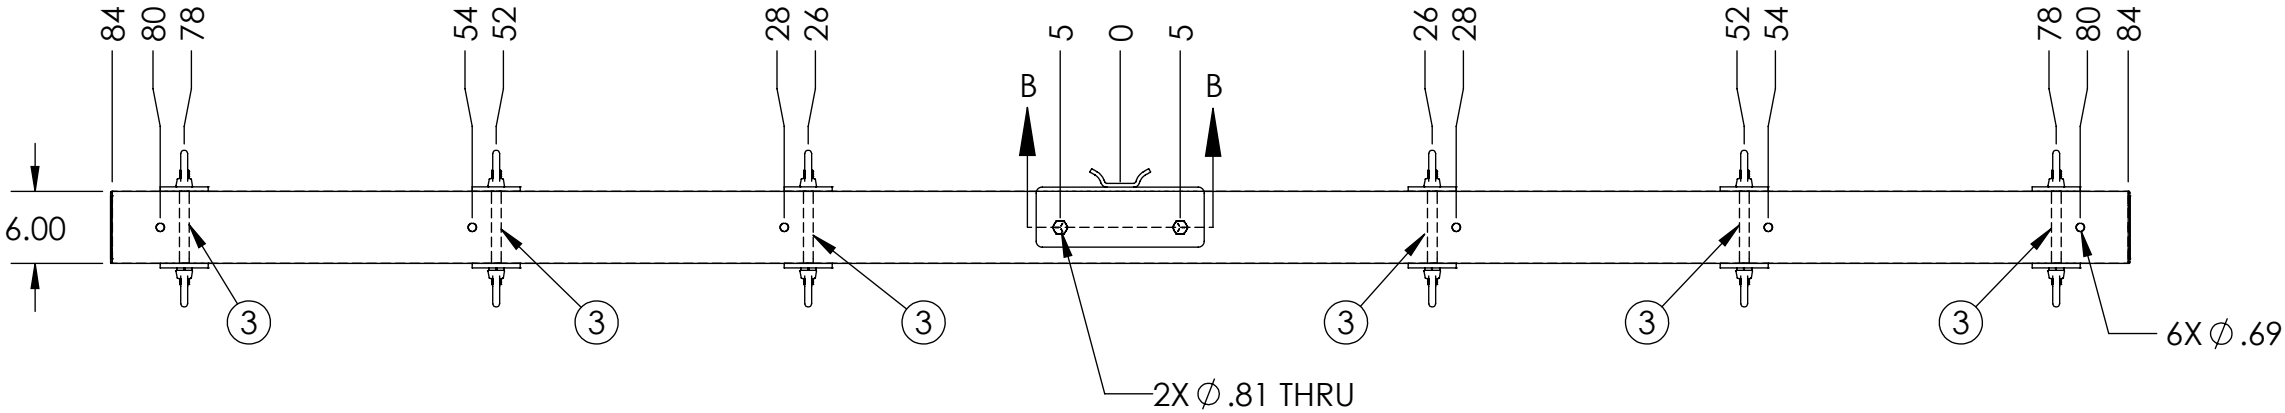
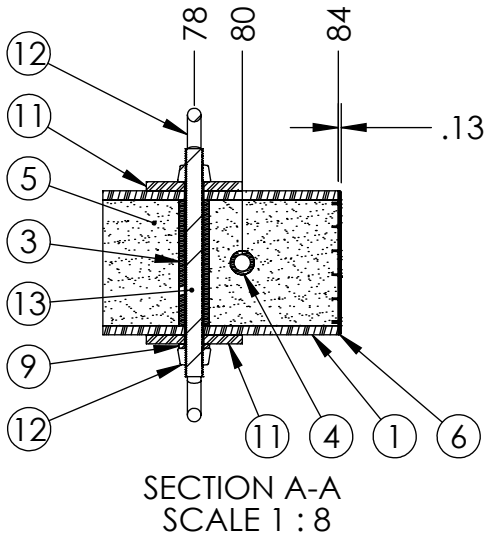


ITEM NO.	PART NUMBER	DESCRIPTION	DESCRIPTION 2	QTY
1	FB-168-4000-2	BEAM, PULTRUDED STOCK	SERIES 4000 x 168 in, GRAY	1
2	TG0813-0054	BUSHING	13/16 in x 3-1/4 in	2
3	TG0813-0053	BUSHING	13/16 in x 5-1/4 in	6
4	TG0688-0052	BUSHING	11/16 in x 3-1/4 in	6
5	FOAM	-	-	1
6	EC40-0006-2	END CAP	SERIES 4000, GRAY	2
7	DM-0006	MOUNT ASSEMBLY, DEADEND	4KLH	1
8	HB0750-0003	HEX BOLT	3/4 in - 10 x 6 in	2
9	LW0750-0001	LOCK WASHER	3/4 in	8
10	HN0750-0001	HEX NUT	3/4 in - 10	2
11	SW0813-0005	SQUARE WASHER	13/16 in, 4 in x 3/8 in	12
12	EN0750-0002	EYE NUT	3/4 in - 10	12
13	TR0750-0003	THREADED ROD	3/4 in - 10 x 9-1/2 in	6

PUPI®
www.pupicrossarms.com

REVISIONS			
REV.	DESCRIPTION	DATE	INITIALS

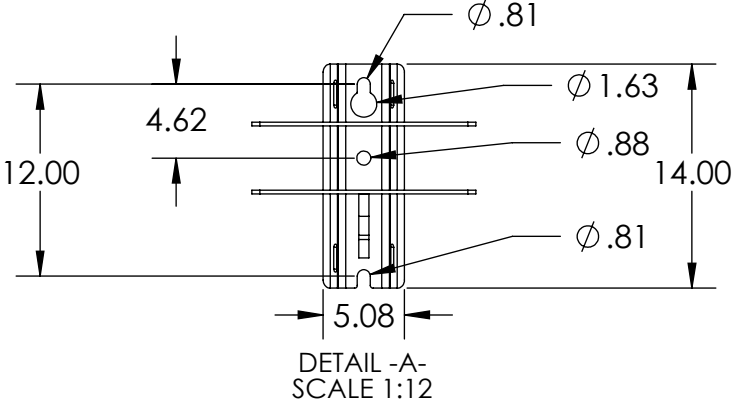

- NOTES:
1. CENTER OF MOUNT HOLE(S) TO HOLES TOLERANCE ± 0.06
 2. CALCULATED AVERAGE ULTIMATE VERTICAL LOAD = 2,250 LBS PER WIRE, 6 WIRES
 3. CALCULATED AVERAGE ULTIMATE LONGITUDINAL LOAD = 6,750 LBS PER WIRE, 6 WIRES
 4. GEOTEK RECOMMENDS THAT FULLY FACTORED DESIGN TENSION AND WEIGHT PER WIRE, INCLUDING ALL OVERLOAD FACTORS, DOES NOT EXCEED 50% OF THE AVERAGE ULTIMATE STRENGTH PER WIRE OF THE CROSSARM

---UNLESS OTHERWISE SPECIFIED---		
DIMENSIONS ARE IN INCHES INTERPRET DIM AND TOL PER ASME Y14.5-2009 ANGULAR: MACH $\pm 2^\circ$ BEND $\pm 2^\circ$ ONE PLACE DECIMAL ± 0.1 TWO PLACE DECIMAL ± 0.02		
PROPRIETARY AND CONFIDENTIAL THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF GEOTEK. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF GEOTEK IS PROHIBITED.		
CUSTOMER SIGNATURE:		
THIRD ANGLE PROJECTION		
DATE:		



1421 SECOND AVE NW
STEWARTVILLE, MN 55976
(800) 533-1680
www.geotekinc.com

DESCRIPTION:
DEADEND ASSEMBLY, SERIES 4000
168 in, CUSTOM SPECIFICATION

SIZE: DWG. NO. **B DA4000168E63052**

SCALE: 1:16 | WEIGHT: 137 LBS

BEAM COLOR: **GRAY**

REV: **0.0**

SHEET 1 OF 1